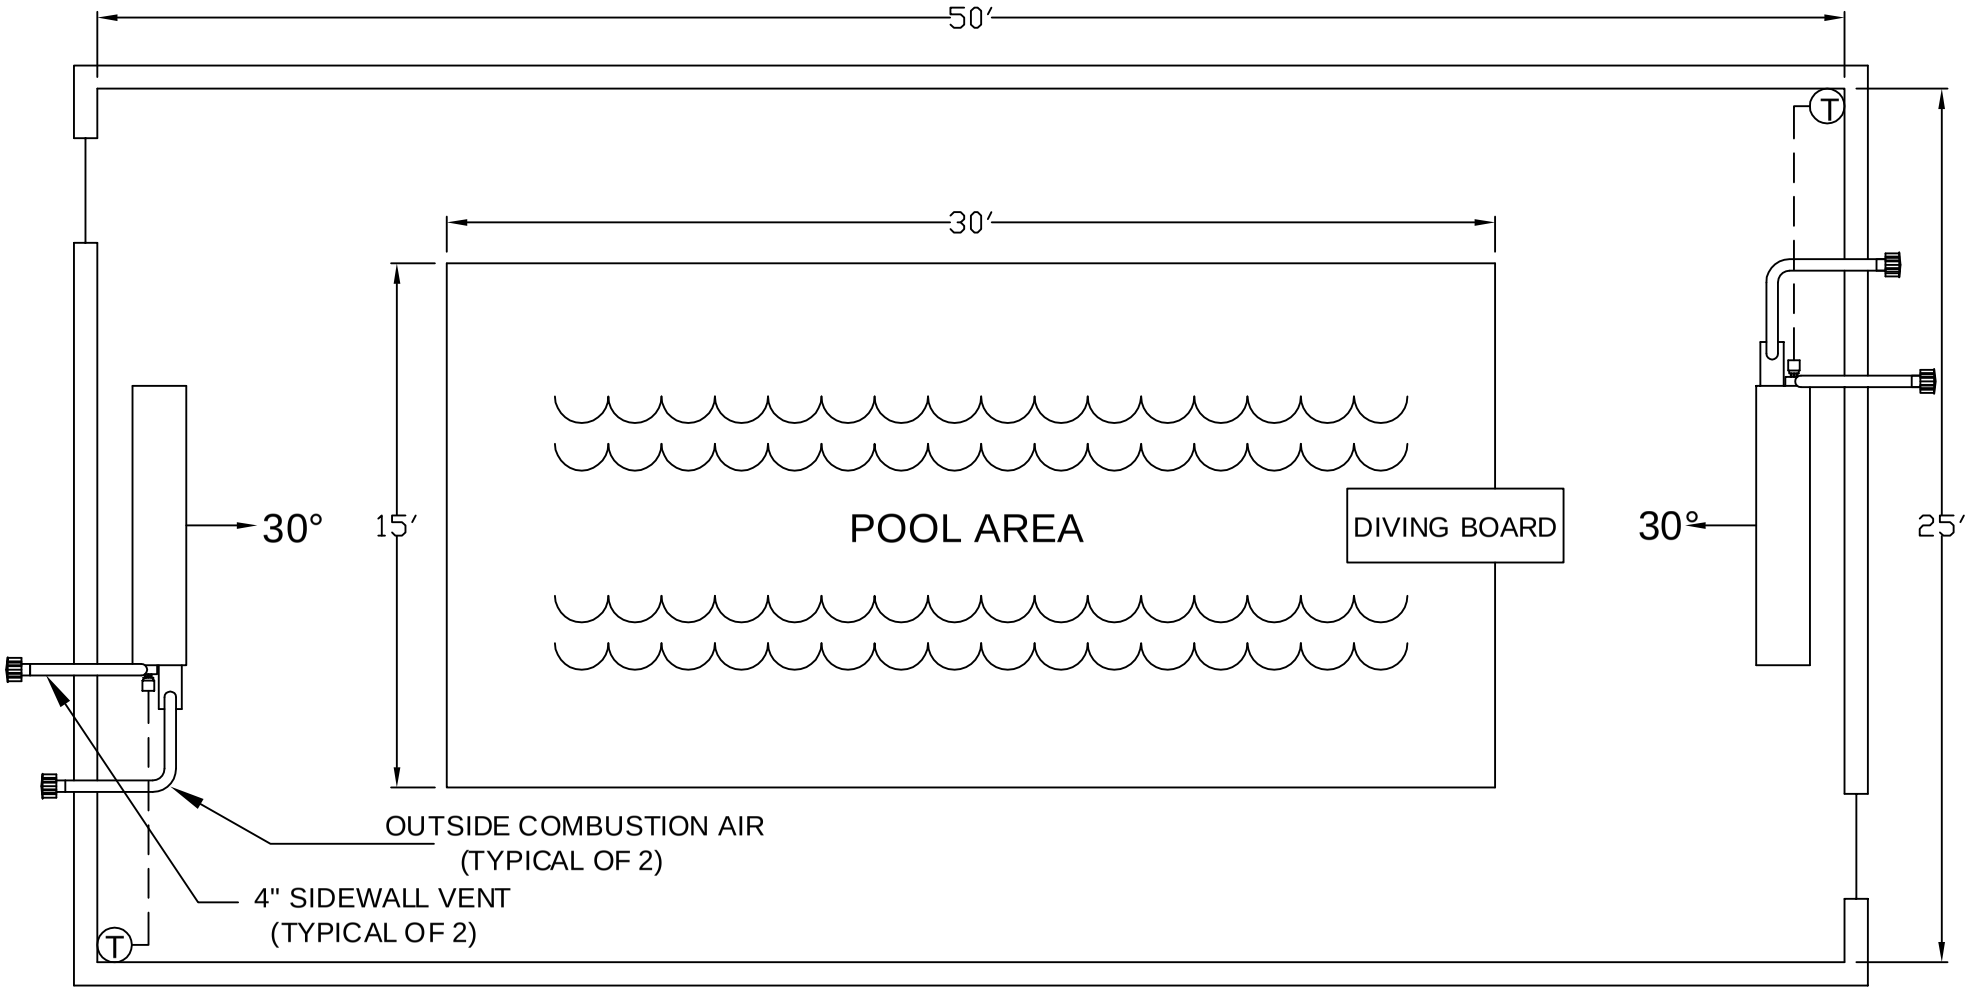

INFRARED HEATING REQUIREMENTS

1. (2) CB50-15 VENTED SPACE-RAY INFRARED HEATERS. INSTALL AT 12 FEET ABOVE FINISHED FLOOR.
2. (2) SPACE-RAY HIGH HUMIDITY ENVIRONMENT THERMOSTATS MOUNTED 5'6" ABOVE FINISHED FLOOR.
3. HEATERS SHALL BE "PULL THROUGH" SYSTEMS (VACUUM) WITH CAST IRON BURNER AND CALORIZED EMITTER TUBES.
4. HEATER, THERMOSTAT LOCATIONS SUBJECT TO FIELD VERIFICATION & COORDINATED WITH OTHER EQUIPMENT IN THE BUILDING.
5. CONSULT HEATER SPECIFICATION SHEET AND I & O INSTRUCTIONS. FOR FURTHER INFORMATION PLEASE VISIT WWW.SPACERAY.COM

SPACE-RAY®
INFRARED GAS HEATERS

Title: INDOOR SWIMMING POOL INSTALLATION DETAIL-1034

Drawn By: RJ Herrington

Date: 16 JUN 05